


RAMP TEXTURE  
PATTERN DETAIL

PLAN VIEW

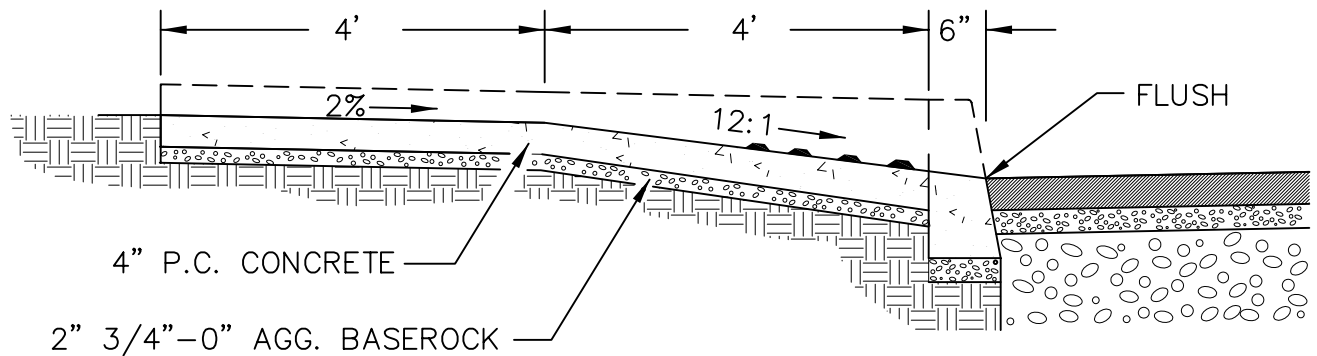

SECTION A-A

NOTES:

1. CONCRETE SHALL ATTAIN A MINIMUM COMPRESSIVE STRENGTH OF 3000 P.S.I. IN 28 DAYS.
2. CONTRACTION JOINTS SHALL BE SCRIBED 3/4" DEEP AND RAMP PANELS SHALL BE BE EDGED ON 4 SIDES.
3. EXPANSION JOINTS SHALL BE 1/2" ASPHALT IMPREGNATED MATERIAL OR EQUAL.
4. SURFACE SHALL HAVE A MEDIUM BROOM FINISH.
5. COLOR OF DOME AREA SHALL BE SAFETY YELLOW.



ENGINEERING DEPARTMENT  
13125 S.W. HALL BLVD.  
TIGARD, OREGON 97223  
VOICE: (503) 639-4171  
FAX: (503) 684-7297

DATE	REVISION
3-10-03	ADD TRUNCATED DOME DETAIL
3-10-03	CONC STRENGTH 3000 TO 3300

**WHEELCHAIR RAMP  
STANDARD CORNER**

NO SCALE

DWG. NO.

**128**